

Specification Sheet



Product Name	BodyBio Ionic Zinc 2 oz		
Company	Trace Minerals		Version # 3
Item Number	FPBBIOZ01	Last Revision Date	8/4/2026

Formula					
Ingredients in Descending Order		Qty[Active]/serving		Provided By:	
Purified Deionized Water		0.953 mL		CLS	
ConcenTrace®		0.297 mL		Customer	
Zinc Sulfate		50 mg		CLS	
Copper Sulfate		2 mg		CLS	
Citric Acid		pH Control		CLS	
Potassium Benzoate (preservative)		1.5 mg		CLS	
Serving Size	1.25 ml	Fill Amount	2 fl oz	Fill Range	2 - 2.1 fl oz

Ingredient Specifications			
☒ Non-GMO	☐ Organic	☒ Allergen Free	☐ Halal
☒ Kosher	☒ Vegan	☒ Gluten Free	☐ All Natural
☐ Other: _____			

Packaging Components	Qty	Provided By:
Bottle - 2 oz Amber Glass, Boston Round, 20-400	1	CLS
Dropper - Black Bulb/Cap, Glass Pipette (91mm), 20-400, Cal. (.25, .50, .75, 1.0)	1	CLS
Label - BodyBio Ionic Zinc 2 oz	1	CLS
Clear Shrink Material	~27mm	CLS
Shipping Box - 6-11/16 x 5 x 4-3/4 Corrugated Single Wall	1/12	CLS
Divider - 12 Cells, Corrugated	1/12	CLS

Label inventories, and the inventories of any other packaging materials or ingredients, will be provided on a monthly basis. It is up to the customer to order appropriate quantities and to keep track of current stock beyond the monthly inventory report.



Services Provided	
☒ Inspection of all ingredients ☒ Identity test on each ingredient ☒ Product mixing/batching ☐ Product pasteurization ☒ Inspection of all packaging components ☒ Filling and capping bottles ☐ Induction seal application ☒ Neck band application ☐ Full body sleeve application ☒ Pressure sensitive label application ☐ Shrink label application	☐ Heat stamp application of lot number ☒ Ink jet application of lot number ☐ Packaging into unit carton (ie. POP display) ☐ Packaging into unit shipper (ie. 12-pack) ☒ Packaging into master shipping box ☒ Palletization and shrink wrap (Wood Pallet) ☐ Palletization and shrink wrap (Plastic Pallet) ☒ Micro testing of finished product ☒ Strength testing of finished product ☒ Heavy metals testing of finished product ☐ Other: _____
*A certificate of analysis is provided with every batch of finished product. Actual test results are available upon request. Access to SOPs and other regulatory information is available upon request. Other documents (SDS, CFS, Dossiers, etc.) are not included and will be charged separately at an agreed price.	

****Some crystallization may occur and is normal for products containing mineral salts****

Physical Tests			
	Specification	Method	Test Group
pH Range	2.3 - 2.9	USP <791>	Every Lot
Brix Range	22 - 29 °Brix	Meter	Every Lot
Specific Gravity	1.149 - 1.245	USP <841>	Every Lot
Color	Light Blue/Green	Organoleptic	Every Lot
Odor	Characteristic	Organoleptic	Every Lot
Taste	Characteristic	Organoleptic	Every Lot
Clarity	Clear	Organoleptic	Every Lot

Purity Tests - Microbial			
	Specification	Method	Test Group
Micros			
Total Plate Count	< 1,000 cfu/g	USP	Every Lot
Coliform Count	< 100 cfu/g	AOAC	Every Lot
E. Coli Count	Absent/10g	USP	Every Lot
S. Aureus	Absent/10g	USP	Every Lot
Salmonella	Absent/10g	USP	Every Lot
Yeast Count	< 100 cfu/g	USP	Every Lot
Mold Count	< 100 cfu/g	USP	Every Lot

Purity Test - Contaminants			
	Specification	Method	Test Group
Heavy Metals			
Arsenic	< 10.0 mcg/serving	ICP-MS	Every Lot
Cadmium	< 4.1 mcg/serving	ICP-MS	Every Lot
Lead	< 0.5 mcg/serving	ICP-MS	Every Lot
Mercury	< 0.3 mcg/serving	ICP-MS (or equivalent)	Every Lot

Potency Tests

	Target (per 1.25 ml)	Acceptable Range (per 1.25 ml)	Method	Test Group
Magnesium	25 mg	25 - 50 mg	ICP-OES	Group A
Zinc	50 mg	50 - 100 mg	ICP-OES	Group B
Copper	2 mg	2 - 4 mg	ICP-OES	Group B
Chloride	55 mg	55 - 137.5 mg	Titration	Group B
Ionic Trace Minerals	350 mg	350 - 490 mg	Input	Evey Lot
Sulfate	60 mg	60 - 120 mg	Titration	Group A
Boron	0.1 mg	0.1 - 0.25 mg	ICP-OES	Group A

Quality Guarantee

CLS utilizes the ANSI/ASQ Z1.4-2003 Acceptance Sampling Tables (Tables I and II-A) to determine sample sizes and acceptance/rejection numbers. We use a General Inspection Level I with the following AQLs.

- Critical Defects: AQL 0%
- Major Defects: AQL 1%
- Minor Defects: AQL 2.5%

CLS Manufacturing strives to maintain a high-quality standard. Typical industry norms set a standard of 1% or less total defects. CLS Manufacturing will rework, credit product, or otherwise rectify the problem to provide customer assurance for quality issues found representing 0.5% or greater, or otherwise significant quality problem trends that are found after receipt. Quality issues found after receipt representing less than 0.5% of the total quantity are attributed to manufacturing variations and will generally not require a formal investigation or product rectification.

Label Verification

The current approved label revision will be used as outlined in CLS L SOP# 1200 Production and Process Control System Packing.

BodyBio Item No: LM202

Defend and Repair*
Critical for immune defense, supporting tissue repair, and enzymatic activity across nearly every system in the body.*

Suggested Use:
As a mineral supplement, add 1.25 mL in water or juice daily, or more as directed by a licensed health care practitioner.
Shake well. Do not refrigerate.

 To learn more about Zinc, scan the QR code

BODYBIO.COM

BODYBIO

Zinc
LIQUID MINERAL

2 FL. OZ. / 59 mL
Mineral Supplement

SUPPLEMENT FACTS
Serving Size: 1.25 mL (25 drops)
Servings: About 47

Amount Per Serving	% DV
Zinc (as zinc sulfate) 50 mg	455%
Copper (as copper sulfate) 2 mg	222%
Ionic Sea Minerals 350 mg Concentrate	†

† Daily Value (DV) not established.

Other Ingredients: Purified water, non-GMO citric acid, <0.2% potassium benzoate.


*These statements have not been evaluated by the Food and Drug Administration. This product is not intended to diagnose, treat, cure or prevent any disease.

7 43474 22012 2

manufactured for/by:
BodyBio
45 Reese Rd.
Millville NJ 08332
Item No: LM202
Label No: 5049

Special Packaging Instructions

Use the customer-specified box label in place of the regular box label. The box label should be printed on a 4" x 3" label with the barcode size at 1.5" x 1":

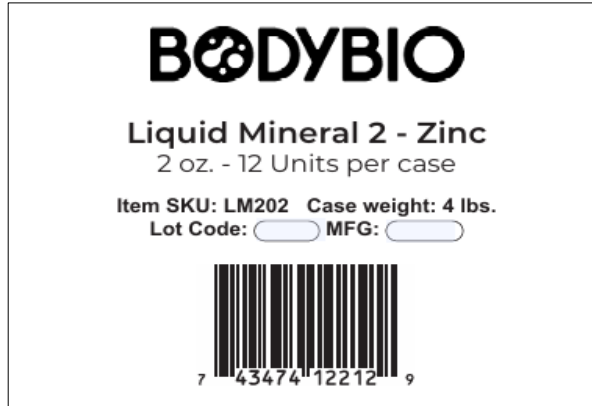

Lot Code Printing

Shelf Life?

☐ No
☒ *Yes 2 yrs

Printing Format



LOT 00000
EXP MM/YYYY

Printing Location:

Lot code and expiration date to be printed on the bottom of the bottle in contrasting ink.

Pallet Configuration

- 12 bottles per case with corrugated dividers
- 49 cases per layer
- Up to 9 layers per pallet (~50 inches pallet height)
- Shipper box sticker placed in upper left side of each case

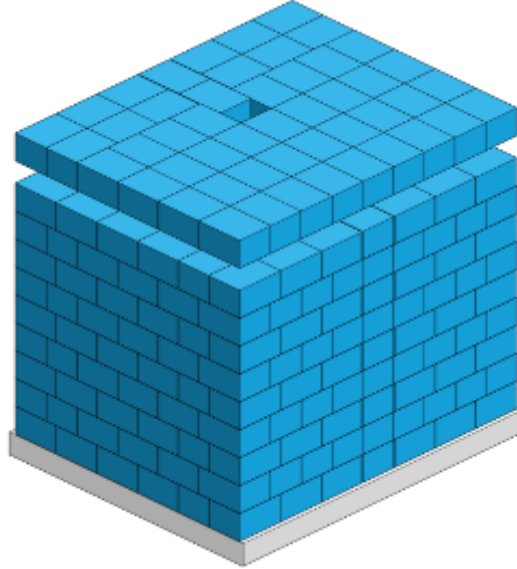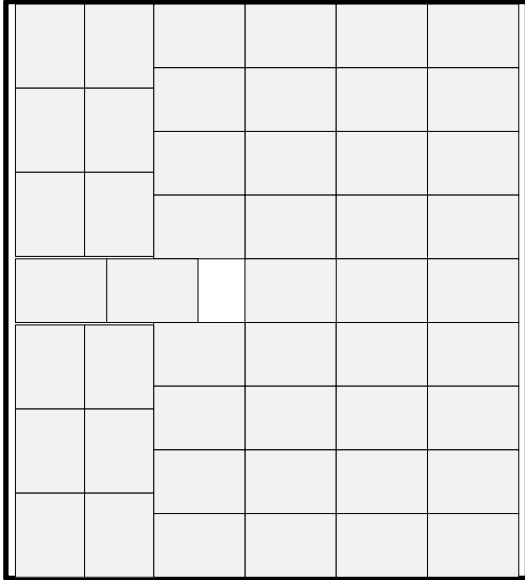

Customer signature of approval is preferred, but not required. E-mail/verbal confirmation is accepted. If no response is received, the specification will be considered approved for the current production run.

Customer Approved:

Date:

Signed Copy



Approved Verbally



Approved by PO



Approved By

Date

CLS Approved:

Date: